

SUBMITTAL DATA



PREMIUM **H** H Series HE

Hydronic Heat Pump with OptiHeat
Single Stage 4-5 Ton \ 60Hz \ R-454B

SDW5-0024S




Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

Nomenclature

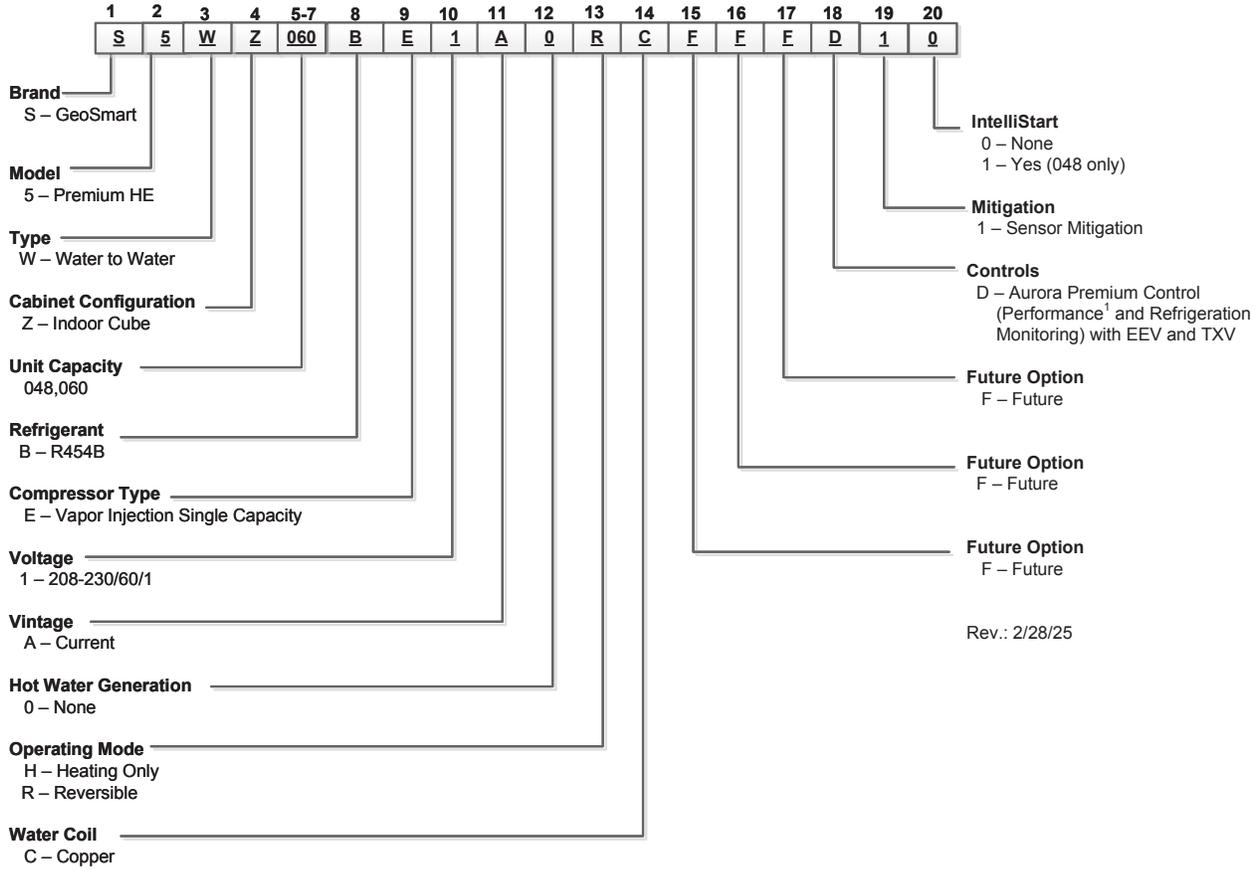

Rev.: 2/28/25

Notes: 1 – Flow meter for Performance option is shipped inside the unit and must be externally field installed.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



AHRI/ISO 13256-2 Performance Ratings

Model	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
			Cooling 86°F Source 53.6°F Load		Heating 68°F Source 104°F Load		Cooling 59°F Source 53.6°F Load		Heating 50°F Source 104°F Load		Cooling 77°F Source 53.6°F Load		Heating 32°F Source 104°F Load	
	Load GPM	Source GPM	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
048	15	15	41,700	13.3	62,700	4.7	44,500	20.1	52,800	3.9	43,000	16.1	42,800	3.3
060	20	20	51,900	13.0	79,600	4.5	57,100	20.1	66,700	3.7	54,200	16.1	54,100	3.2

3/17/25


©2025 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

Dimensional Data

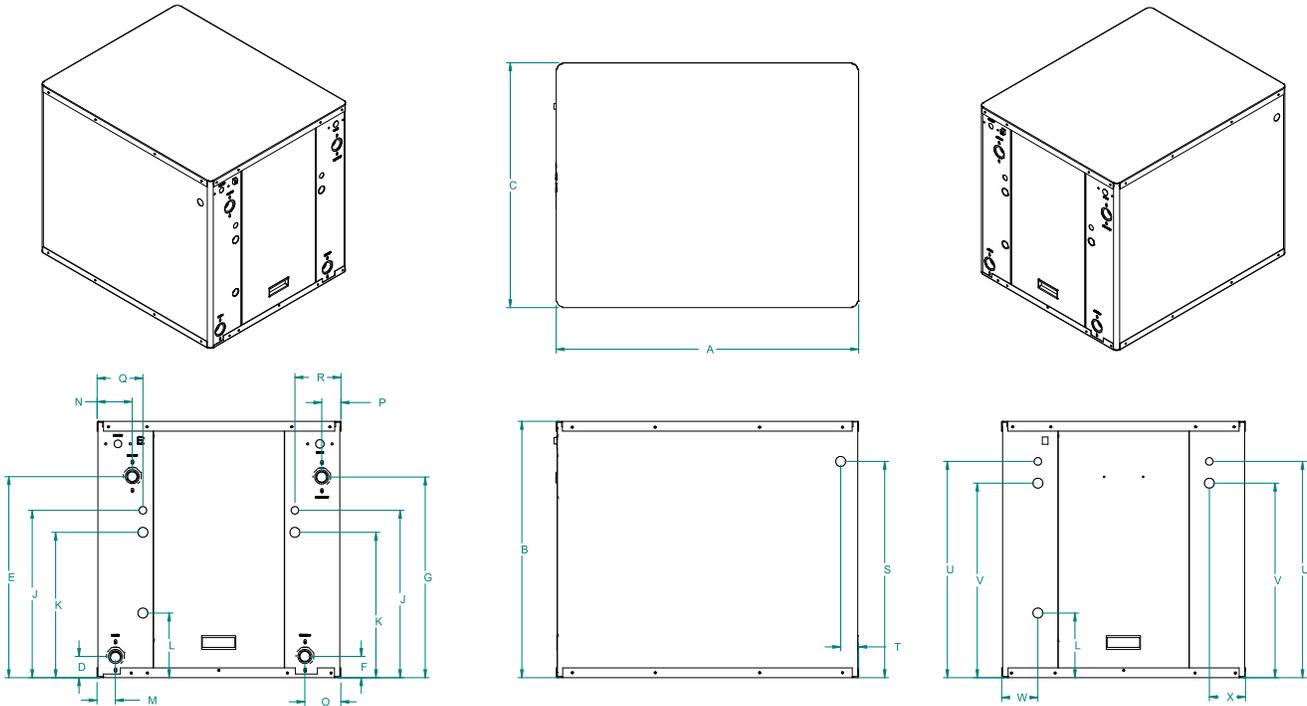

Model	Overall Cabinet			Water Connections						Electrical Knockouts			
	A	B	C	D	E	F	G			J	K	L	
	Depth	Height	Width	Load Liquid In	Load Liquid Out	Source Liquid In	Source Liquid Out	Load Water FPT	Source Water FPT	1/2" cond Low Voltage	3/4" cond High Voltage	3/4" cond High Voltage	
048	in.	31.0	26.2	25.0	2.2	20.6	2.2	20.6	1-1/4"	1-1/4"	17.1	14.8	6.5
	mm	787.4	665.5	635.0	55.9	523.2	55.9	523.2	31.8	31.8	434.3	375.9	165.0
060	in.	31.0	26.2	25.0	2.4	23.3	2.4	23.3	1-1/4"	1-1/4"	18.0	15.8	6.5
	mm	787.4	665.5	635.0	61.0	592.0	61.0	592.0	31.8	31.8	457.0	401.0	165.0

Model	Water Connections				Electrical Knockout		Electrical Knockout		Electrical Knockout		Electrical Knockout		
	M	N	O	P	Q	R	S	T	U	V	W	X	
	Load Liquid In	Load Liquid Out	Source Liquid In	Source Liquid Out	High/Low Voltage	High/Low Voltage	Power Supply	Power Supply	Low Voltage	Power Supply	High/Low Voltage	High/Low Voltage	
048	in.	1.8	3.6	3.6	2.0	4.7	4.7	22.0	1.8	22.0	19.8	3.7	3.7
	mm	45.7	91.4	91.4	50.8	119.4	119.4	559.0	45.7	559.0	503.0	94.0	94.0
060	in.	1.8	4.0	4.0	1.8	4.7	4.7	22.0	1.8	22.0	19.8	3.7	3.7
	mm	45.7	101.6	101.6	45.7	119.4	119.4	559.0	45.7	559.0	503.0	94.0	94.0

©2025 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



Physical Data

Model	048	060
Compressor (1 each)		
Factory Charge R-454B, oz [kg]	100 [2.83]	118 [3.34]
Coax & Piping Water Volume - gal [l]	1.4 [5.25]	1.6 [6.13]
Weight - Operating, lb [kg]	340 [154.2]	360 [163.3]
Weight - Packaged, lb [kg]	355 [161.0]	375 [170.0]

3/17/25

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



Electrical Data

Model	Rated Voltage	Voltage Min/Max	Compressor				Load Pump	Source Pump	Total Unit FLA	Min Ckt Amp	Maximum Fuse/HACR
			MCC	RLA	LRA	LRA*					
048	208-230/60/1	198/254	37.8	24.2	178.0	62.0	1.8	5.4	31.4	37.5	60
060	208-230/60/1	198/254	40.3	25.8	178.0	62.0	1.8	5.4	33.0	39.5	60

3/17/25

Notes: All fuses type "D" time delay (or HACR circuit breaker in USA).

Source pump amps shown are for up to a 1/2 HP pump

Load pump amps shown are for small circulators.

*LRA with IntelliStart installed

Contractor: _____ P.O.: _____
 Engineer: _____
 Project Name: _____ Unit Tag: _____

Definitions

Abbreviations and Definitions

ELT = entering load fluid temperature to heat pump	kW = kilowatts
SWPD = source coax water pressure drop	EST = entering source fluid temperature to heat pump
LLT = leaving load fluid temperature from heat pump	HE = heat extracted in MBTUH
PSI = pressure drop in pounds per square inch	LST = leaving source fluid temperature from heat pump
LGPM = load flow in gallons per minute	HC = total heating capacity in MBTUH
FT HD = pressure drop in feet of head	COP = coefficient of performance, heating [HC/kW x 3.413]
LWPD = load coax water pressure drop	EER = energy efficiency ratio, cooling
LWT = leaving water temperature	TC = total cooling capacity in MBTUH
EWT = entering water temperature	HR = heat rejected in MBTUH
Brine = water with a freeze inhibiting solution	

Reference Calculations

Heating Calculations: $LWT = EWT - \frac{HE}{GPM \times C^*}$ $HE = C^* \times GPM \times (EWT - LWT)$	Cooling Calculations: $LWT = EWT + \frac{HR}{GPM \times C^*}$ $HR = C^* \times GPM \times (LWT - EWT)$
--	--

NOTE: * C = 500 for pure water, 485 for brine.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



Pressure Drop

Model	GPM	Pressure Drop (psi)						
		30°F	50°F	70°F	90°F	110°F	130°F	150°F
048	8.0	1.7	1.4	1.4	1.3	1.3	1.2	1.1
	11.5	3.6	3.4	3.2	3.0	2.8	2.6	2.5
	15.0	5.7	5.5	5.1	4.6	4.4	4.3	4.1
	18.5	8.4	8.2	7.7	7.3	6.9	6.7	6.5
060	10.0	3.2	3.0	2.8	2.7	2.5	2.4	2.3
	14.5	5.6	5.4	5.2	4.9	4.7	4.6	4.5
	19.0	8.0	7.7	7.4	7.2	6.9	6.7	6.6
	23.5	11.6	11.4	11.1	10.9	10.4	10.2	10.0

4/10/25

Contractor: _____ P.O.: _____
 Engineer: _____
 Project Name: _____ Unit Tag: _____

Performance Data

048 - Heating

Source		Load Flow - 11.5 GPM							Load Flow - 15 GPM					Load Flow - 18.5 GPM						
EST °F	Flow GPM	ELT °F	LLT °F	HC kBTUH	Power kW	HE kBTUH	COP	LST °F	LLT °F	HC kBTUH	Power kW	HE kBTUH	COP	LST °F	LLT °F	HC kBTUH	Power kW	HE kBTUH	COP	LST °F
30	8	60	66.9	41.3	2.41	33.1	4.77	20.9	65.2	41.6	2.35	33.6	4.93	20.7	64.1	41.9	2.29	34.1	5.09	20.6
		80	86.8	42.0	3.09	31.5	3.79	21.3	85.1	42.4	3.01	32.1	3.92	21.1	84.0	42.7	2.94	32.7	4.05	21.0
		100	106.8	42.9	3.72	30.2	3.21	21.7	105.0	43.2	3.63	30.8	3.32	21.5	103.9	43.5	3.54	31.5	3.43	21.3
		130	136.8	44.9	4.82	28.4	2.59	22.1	135.0	45.2	4.70	29.2	2.68	21.9	133.8	45.5	4.58	29.9	2.77	21.7
		135	141.8	45.1	5.16	27.4	2.44	22.4	140.0	45.4	5.04	28.2	2.52	22.2	138.8	45.7	4.91	29.0	2.59	30.9
		140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
	12	60	67.0	42.1	2.42	33.8	4.84	22.8	65.3	42.4	2.36	34.4	5.00	22.7	64.2	42.7	2.30	34.9	5.16	22.6
		80	87.0	42.8	3.10	32.3	3.85	23.2	85.2	43.2	3.03	32.8	3.97	23.1	84.1	43.5	2.95	33.4	4.11	22.9
		100	106.9	43.6	3.73	30.9	3.26	23.5	105.1	43.9	3.64	31.5	3.36	23.3	104.0	44.3	3.55	32.2	3.47	23.2
		130	136.9	45.2	4.83	28.7	2.60	23.9	135.0	45.5	4.71	29.4	2.69	23.7	133.9	45.8	4.60	30.2	2.78	23.6
		135	141.9	45.3	5.18	27.7	2.45	24.1	140.0	45.7	5.06	28.4	2.53	23.9	138.8	46.0	4.93	29.2	2.60	28.2
		140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
15	60	67.2	42.9	2.43	34.6	4.91	24.8	65.4	43.2	2.38	35.1	5.07	24.7	64.3	43.5	2.32	35.6	5.24	24.7	
	80	87.1	43.7	3.12	33.0	3.90	25.0	85.3	44.0	3.04	33.6	4.03	25.0	84.2	44.3	2.96	34.2	4.16	24.9	
	100	107.0	44.3	3.74	31.6	3.30	25.3	105.2	44.7	3.65	32.2	3.41	25.2	104.1	45.0	3.56	32.8	3.52	25.1	
	130	136.9	45.4	4.85	28.9	2.61	25.6	135.1	45.8	4.73	29.6	2.69	25.5	133.9	46.1	4.61	30.4	2.78	25.4	
	135	141.9	45.6	5.20	27.9	2.45	25.8	140.0	46.0	5.07	28.7	2.53	25.7	138.9	46.3	4.95	29.4	2.61	25.6	
	140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended						
50	8	60	67.8	46.6	2.31	38.7	5.61	39.2	65.9	46.9	2.26	39.2	5.79	39.1	64.7	47.3	2.20	39.8	5.98	38.9
		80	87.9	48.2	3.13	37.5	4.28	39.5	85.9	48.6	3.06	38.1	4.43	39.4	84.7	48.9	2.98	38.8	4.57	39.2
		100	108.1	50.1	3.78	37.2	3.69	39.6	106.0	50.5	3.69	37.9	3.81	39.4	104.7	50.9	3.59	38.6	3.94	39.3
		130	138.4	53.6	4.86	37.0	3.07	39.7	136.2	54.0	4.75	37.8	3.17	39.5	134.8	54.4	4.63	38.6	3.28	39.2
		135	143.5	54.1	5.20	36.3	2.91	39.9	141.2	54.5	5.08	37.2	3.00	39.6	139.8	54.9	4.95	38.0	3.09	39.4
		140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
	12	60	68.0	47.5	2.33	39.5	5.68	42.2	66.0	47.8	2.27	40.1	5.87	42.1	64.8	48.2	2.21	40.6	6.07	42.0
		80	88.1	49.3	3.13	38.6	4.38	42.4	86.1	49.7	3.06	39.3	4.53	42.3	84.8	50.1	2.98	39.9	4.68	42.2
		100	108.3	51.2	3.94	37.7	3.61	42.6	106.2	51.6	3.85	38.5	3.73	42.4	104.9	52.0	3.75	39.2	3.86	42.3
		130	138.5	54.0	5.16	36.4	2.91	42.8	136.3	54.4	5.03	37.2	3.01	42.7	134.9	54.8	4.90	38.1	3.11	42.5
		135	143.5	54.4	5.36	36.2	2.83	42.9	141.3	54.8	5.23	37.0	2.92	42.7	139.9	55.3	5.10	37.9	3.02	42.8
		140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
15	60	68.2	48.4	2.34	40.4	5.76	43.8	66.2	48.7	2.28	41.0	5.95	43.8	64.9	49.1	2.22	41.5	6.15	43.7	
	80	88.3	50.1	3.16	39.3	4.40	44.0	86.2	50.4	3.09	39.9	4.55	43.9	84.9	50.8	3.01	40.6	4.70	43.8	
	100	108.4	51.8	3.80	38.8	3.80	44.1	106.2	52.2	3.71	39.5	3.92	44.0	104.9	52.5	3.61	40.2	4.05	43.9	
	130	138.5	54.3	4.90	37.6	3.09	44.2	136.3	54.7	4.78	38.4	3.19	44.1	134.9	55.1	4.66	39.2	3.29	44.0	
	135	143.5	54.4	5.36	36.2	2.83	42.9	141.3	55.2	5.11	37.8	3.02	44.2	139.9	55.6	4.98	38.6	3.12	44.1	
	140	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended						
70	8	60	69.5	55.6	2.36	47.6	6.57	56.7	67.4	57.3	2.35	49.2	6.78	56.2	66.0	58.9	2.34	50.9	7.00	55.8
		80	89.7	57.9	3.53	45.8	4.56	57.2	87.4	59.2	3.51	47.3	4.70	56.8	86.0	60.6	3.49	48.7	4.84	56.4
		100	109.9	60.3	4.32	45.5	3.88	57.3	107.6	61.6	3.91	48.2	4.39	56.5	106.1	62.9	3.49	51.0	5.01	55.8
		125	135.2	63.2	5.61	44.0	3.17	57.7	132.7	64.3	5.00	47.2	3.61	56.8	131.1	65.4	4.40	50.4	4.14	55.9
		130	140.3	63.7	5.87	43.7	3.02	57.7	137.7	64.8	5.22	47.0	3.45	56.9	136.1	65.9	4.58	50.3	3.91	56.2
		135	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
	12	60	69.7	57.1	2.35	49.0	6.75	60.3	67.5	58.4	2.36	50.3	6.88	60.1	66.1	59.7	2.37	51.6	7.00	59.8
		80	89.9	59.3	3.40	47.7	4.86	60.6	87.5	59.9	3.25	48.8	5.14	60.4	86.0	60.6	3.10	50.0	5.44	60.1
		100	110.1	61.5	4.44	46.3	3.86	60.8	107.5	61.5	4.13	47.4	4.14	60.6	105.9	61.5	3.83	48.4	3.98	61.0
		125	135.4	64.2	5.74	44.6	3.15	61.1	132.6	63.4	5.24	45.6	3.40	61.0	130.8	62.6	4.74	46.5	3.68	61.2
		130	140.4	64.8	6.00	44.3	3.00	61.2	137.6	63.8	5.46	45.2	3.25	61.0	135.8	62.9	4.92	46.1	3.56	61.2
		135	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
15	60	70.0	58.5	2.35	50.5	6.94	62.3	67.7	59.5	2.38	51.4	6.97	62.1	66.2	60.4	2.40	52.2	7.01	62.0	
	80	90.3	61.1	3.54	49.1	4.81	62.5	87.7	61.5	3.54	49.4	4.83	62.4	86.2	61.9	3.55	49.8	4.86	62.4	
	100	110.6	63.8	4.34	49.0	4.09	62.5	107.8	63.6	3.93	50.2	4.51	62.3	106.1	63.4	3.52	51.4	4.17	62.3	
	125	135.8	66.7	5.66	47.4	3.32	62.7	132.8	65.3	5.04	48.1	3.65	62.6	131.0	63.9	4.42	49.9	4.03	62.3	
	130	140.9	67.2	5.92	47.0	3.16	62.8	137.8	65.6	5.26	47.7	3.47	62.7	135.9	64.1	4.60	48.4	3.79	62.6	
	135	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended						
90	8	60	71.3	65.9	2.20	58.4	8.34	73.6	68.6	66.4	2.16	59.0	8.55	73.5	66.9	66.9	2.13	59.7	8.77	73.3
		80	91.3	67.0	3.06	56.6	6.09	74.1	88.6	67.5	3.01	57.2	6.25	73.9	86.9	68.0	2.96	57.9	6.41	73.8
		100	111.8	70.6	3.80	57.7	5.18	73.8	108.9	71.2	3.73	58.4	5.31	73.6	107.1	71.7	3.67	56.3	4.57	74.2
		125	136.7	71.2	4.95	54.3	4.05	74.7	133.7	71.7	4.87	55.1	4.16	74.5	131.9	72.3	4.78	56.0	4.21	74.3
		130	141.6	71.3	5.18	53.6	3.83	74.9	138.7	71.8	5.09	54.5	3.93	74.7	136.9	72.4	5.00	55.2	4.15	74.5
		135	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended					
	12	60	71.6	67.2	2.21	59.6	8.46	77.1	68.8	67.7	2.17	60.3	8.67	77.0	67.1	68.2	2.14	60.9	8.89	76.9
		80	91.6	68.3	3.08	57.8	6.18	77.5	88.8	68.8	3.02	58.5	6.33	77.4	87.0	69.3	2.97	59.2	6.49	77.2
		100	112.0	71.8	3.81	58.8	5.25	77.3	109.1	72.3	3.74	59.6	5.38	77.1	107.2	72.9	3.68	58.9	5.08	77.4
		120	134.3	71.8	4.85	55.3	4.20	78.0	131.3	72.4	4.77	56.1	4.30	77.8	129.5	72.9	4.69	56.9	4.34	77.7
		125	139.2	71.8	5.08	54.5	3.96	78.2	136.3	72.4	5.00	55.3	4.06	78.0	134.4	72.9	4.91	56.1	4.20	77.8
		130	141.7	71.9	5.19	55.0	3.84	79.1	138.9	72.5	5.11	54.6	3.94	79.1	136.5	73.0	4.33	54.1	4.11	79.2
135	Operation Not Recommended							Operation Not Recommended					Operation Not Recommended							
15	60	71.8	68.5																	

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

Performance Data cont.

048 - Cooling

Source		Load Flow - 11.5 GPM							Load Flow - 15 GPM					Load Flow - 18.5 GPM							
EST °F	Flow GPM	ELT °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F	
50	8	50	41.7	42.8	2.16	50.2	18.9	62.8	43.5	43.4	2.16	50.8	19.1	62.9	44.5	44.0	2.16	51.4	19.4	63.1	64.0
		70	61.0	46.0	2.19	53.5	20.0	63.6	62.8	46.6	2.19	54.1	20.3	63.8	64.0	47.3	2.19	54.8	20.5	64.0	64.8
		90	80.2	49.2	2.22	56.7	21.1	64.5	82.2	49.9	2.21	57.4	21.4	64.7	83.4	50.6	2.21	58.1	21.7	64.8	65.7
		110	99.4	52.4	2.25	60.0	22.2	65.3	101.5	53.1	2.24	60.8	22.5	65.5	102.8	53.8	2.24	61.5	22.8	65.7	66.7
	12	50	41.9	42.0	2.15	49.4	18.6	58.6	43.6	42.6	2.15	49.9	18.8	58.7	44.6	43.1	2.15	50.4	19.0	58.8	59.4
		70	61.1	45.3	2.16	52.7	19.9	59.2	62.9	45.9	2.16	53.2	20.2	59.3	64.1	46.5	2.16	53.8	20.4	59.4	60.0
		90	80.3	48.5	2.17	56.0	21.3	59.8	82.3	49.2	2.17	56.6	21.5	59.9	83.5	49.8	2.17	57.2	21.8	60.1	60.7
		110	99.5	51.8	2.18	59.3	22.5	60.4	101.6	52.5	2.18	59.9	22.9	60.5	102.9	53.2	2.18	60.6	23.2	60.7	61.3
	15	50	42.0	41.3	2.13	48.5	18.4	56.4	43.7	41.7	2.14	49.0	18.5	56.5	44.7	42.2	2.14	49.5	18.7	56.5	57.0
		70	61.2	44.6	2.13	51.8	19.9	56.9	63.0	45.1	2.13	52.4	20.1	57.0	64.2	45.6	2.13	52.9	20.3	57.0	57.5
		90	80.4	47.9	2.12	55.2	21.4	57.3	82.4	48.5	2.13	55.7	21.7	57.4	83.6	49.1	2.13	56.3	21.9	57.5	58.0
		110	99.6	51.2	2.12	58.5	23.0	57.8	101.7	51.9	2.12	59.1	23.3	57.9	103.0	52.5	2.12	59.8	23.6	58.0	58.5
70	8	50	42.7	37.7	2.56	46.4	14.0	81.6	44.2	38.3	2.56	47.0	14.2	81.8	45.1	38.9	2.56	47.6	14.4	81.9	83.6
		70	61.4	43.8	2.60	52.7	16.0	83.3	63.1	44.4	2.60	53.3	16.2	83.4	64.2	45.0	2.60	53.9	16.4	83.6	85.3
		90	80.1	49.9	2.65	59.0	17.9	84.9	82.1	50.6	2.65	59.6	18.1	85.1	83.3	51.2	2.65	60.3	18.4	85.3	86.9
		110	98.7	56.0	2.70	65.2	19.7	86.6	101.0	56.7	2.70	65.9	20.0	86.7	102.4	57.4	2.70	66.6	20.2	86.9	88.5
	12	50	42.8	37.2	2.54	45.9	13.9	77.9	44.3	37.7	2.55	46.4	14.1	77.9	45.2	38.2	2.55	46.9	14.3	78.0	79.2
		70	61.4	43.4	2.57	52.2	16.0	79.0	63.2	44.0	2.57	52.8	16.3	79.1	64.3	44.6	2.57	53.3	16.5	79.2	80.4
		90	80.1	49.6	2.60	58.5	18.2	80.1	82.1	50.3	2.60	59.1	18.4	80.3	83.4	50.9	2.60	59.8	18.6	80.4	81.5
		110	98.8	55.8	2.62	64.8	20.2	81.3	101.0	56.5	2.62	65.5	20.5	81.4	102.5	57.2	2.62	66.2	20.7	81.5	82.7
	15	50	42.9	36.7	2.53	45.3	13.8	75.8	44.3	37.2	2.53	45.8	13.9	75.9	45.3	37.6	2.54	46.3	14.1	76.0	76.9
		70	61.5	43.0	2.54	51.7	16.1	76.7	63.2	43.6	2.54	52.2	16.3	76.8	64.3	44.1	2.54	52.8	16.5	76.9	77.8
		90	80.2	49.3	2.54	58.0	18.4	77.6	82.2	49.9	2.54	58.6	18.7	77.7	83.4	50.6	2.55	59.3	18.9	77.8	78.7
		110	98.8	55.6	2.55	64.3	20.8	78.5	101.1	56.3	2.55	65.0	21.0	78.6	102.5	57.0	2.55	65.8	21.2	78.7	79.7
90	8	50	43.6	32.6	2.96	42.7	10.5	100.5	44.9	33.2	2.96	43.2	10.7	100.7	45.7	33.7	2.95	43.8	10.8	100.8	103.2
		70	61.8	41.6	3.02	52.0	13.1	102.9	63.4	42.2	3.02	52.5	13.3	103.1	64.5	42.8	3.02	53.1	13.5	103.2	105.7
		90	79.9	50.7	3.09	61.2	15.6	105.4	82.0	51.3	3.09	61.8	15.8	105.5	83.3	51.9	3.09	62.4	16.0	105.7	108.1
		110	98.1	59.7	3.16	70.4	18.0	107.8	100.5	60.3	3.15	71.1	18.2	107.9	102.0	61.0	3.15	71.7	18.4	108.1	110.5
	12	50	43.6	32.4	2.94	42.4	10.4	97.1	44.9	32.9	2.94	42.9	10.6	97.2	45.7	33.4	2.94	43.4	10.8	97.3	99.0
		70	61.8	41.5	2.98	51.7	13.2	98.8	63.4	42.1	2.98	52.3	13.4	98.9	64.5	42.7	2.98	52.9	13.6	99.0	100.7
		90	79.9	50.7	3.02	61.0	15.9	100.5	82.0	51.3	3.02	61.7	16.1	100.6	83.2	52.0	3.03	62.3	16.3	100.7	102.4
		110	98.1	59.9	3.06	70.3	18.6	102.2	100.5	60.6	3.07	71.0	18.8	102.3	102.0	61.3	3.07	71.7	19.0	102.4	104.1
	15	50	43.7	32.1	2.93	42.1	10.4	95.2	45.0	32.6	2.93	42.6	10.6	95.3	45.8	33.1	2.93	43.1	10.7	95.4	96.7
		70	61.8	41.4	2.94	51.5	13.4	96.5	63.5	42.0	2.95	52.0	13.5	96.6	64.5	42.6	2.95	52.6	13.7	96.7	98.0
		90	79.9	50.7	2.96	60.8	16.3	97.8	82.0	51.4	2.96	61.5	16.5	97.9	83.2	52.1	2.97	62.2	16.7	98.0	100.0
		110	98.0	60.0	2.97	70.2	19.2	99.2	100.5	60.8	2.98	71.0	19.4	99.3	102.0	61.5	2.99	71.7	19.6	99.4	101.7
110	8	50	44.5	27.6	3.36	39.0	7.8	119.4	45.6	28.0	3.35	39.5	7.9	119.5	46.3	28.5	3.35	39.9	8.1	119.7	122.9
		70	62.1	39.5	3.44	51.2	10.9	122.6	63.7	40.0	3.44	51.7	11.0	122.7	64.7	40.5	3.44	52.2	11.2	122.9	126.1
		90	79.8	51.4	3.53	63.4	13.8	125.8	81.9	52.0	3.52	64.0	14.0	126.0	83.2	52.5	3.52	64.6	14.2	126.1	129.3
		110	97.4	63.3	3.61	75.6	16.7	129.0	100.0	63.9	3.61	76.3	16.8	129.2	101.6	64.6	3.61	76.9	17.0	129.3	132.5
	12	50	44.5	27.5	3.34	38.9	7.8	116.3	45.6	28.0	3.34	39.4	8.0	116.4	46.3	28.5	3.34	39.9	8.1	116.5	119.8
		70	62.1	39.6	3.40	51.2	11.1	118.5	63.7	40.2	3.40	51.8	11.2	118.6	64.7	40.8	3.40	52.4	11.4	118.8	122.0
		90	79.7	51.8	3.45	63.5	14.3	120.8	81.8	52.4	3.45	64.2	14.4	120.9	83.1	53.0	3.46	64.8	14.6	121.0	124.2
		110	97.3	63.9	3.50	75.8	17.3	123.0	99.9	64.6	3.51	76.6	17.5	123.1	101.5	65.3	3.52	77.3	17.6	123.3	126.4
	15	50	44.5	27.5	3.33	38.9	7.9	114.6	45.6	28.0	3.33	39.4	8.0	114.7	46.3	28.5	3.32	39.9	8.2	114.8	117.0
		70	62.1	39.8	3.35	51.3	11.3	116.4	63.7	40.4	3.35	51.9	11.5	116.5	64.7	41.0	3.36	52.5	11.6	116.5	119.2
		90	79.7	52.1	3.37	63.6	14.7	118.1	81.8	52.8	3.38	64.4	14.9	118.2	83.1	53.6	3.39	65.1	15.0	118.3	121.4
		110	97.2	64.5	3.39	76.0	18.0	119.8	99.8	65.3	3.41	76.9	18.2	119.9	101.5	66.1	3.42	77.7	18.3	120.1	123.6

Load flow may have to be adjusted based on source temperature variations.

4/8/25

©2025 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: _____ P.O.: _____
Engineer: _____
Project Name: _____ Unit Tag: _____

Performance Data

060 - Heating

Source		Load Flow - 15 GPM								Load Flow - 20 GPM					Load Flow - 25 GPM					
EST	Flow	ELT	LLT	HC	Power	HE	COP	LST	LLT	HC	Power	HE	COP	LST	LLT	HC	Power	HE	COP	LST
°F	GPM	°F	°F	kBTUH	kW	kBTUH		°F	°F	kBTUH	kW	kBTUH		°F	°F	kBTUH	kW	kBTUH		°F
30	10	60	66.5	50.9	2.83	41.3	5.02	20.9	64.7	51.3	2.76	41.9	5.18	20.8	63.7	51.7	2.69	42.5	5.35	20.6
		80	86.4	51.8	3.67	39.2	3.92	21.3	84.6	52.1	3.58	39.9	4.05	21.2	83.6	52.5	3.49	40.6	4.19	21.0
		100	106.3	52.8	4.77	36.6	3.09	21.9	104.5	53.2	4.65	37.4	3.19	21.7	103.5	53.6	4.53	38.2	3.29	21.6
		130	136.4	55.2	6.38	33.4	2.41	22.6	134.5	55.6	6.23	34.4	2.49	22.4	133.4	56.0	6.07	35.3	2.57	22.2
		135	141.3	55.4	6.76	32.3	2.29	22.8	139.5	55.8	6.59	33.3	2.36	22.6	138.3	56.2	6.43	34.3	2.43	22.4
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	15	60	66.6	51.9	2.84	42.2	5.09	23.0	64.9	52.3	2.77	42.9	5.25	22.9	63.8	52.7	2.70	43.5	5.43	22.8
		80	86.5	52.7	3.69	40.2	3.98	23.3	84.7	53.1	3.60	40.9	4.11	23.2	83.7	53.5	3.51	41.6	4.25	23.1
		100	106.5	53.7	4.78	37.4	3.13	23.8	104.6	54.1	4.66	38.2	3.23	23.7	103.5	54.5	4.55	39.0	3.34	23.5
		130	136.4	55.6	6.40	33.7	2.42	24.4	134.5	56.0	6.25	34.7	2.49	24.2	133.4	56.4	6.09	35.6	2.58	24.0
		135	141.4	55.7	6.78	32.6	2.30	24.5	139.5	56.2	6.62	33.6	2.37	24.4	138.4	56.6	6.45	34.6	2.44	24.2
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	20	60	66.7	52.9	2.86	43.2	5.16	25.1	65.0	53.3	2.79	43.8	5.33	25.1	63.9	53.7	2.72	44.4	5.50	25.0
		80	86.7	53.7	3.71	41.1	4.03	25.4	84.8	54.2	3.62	41.8	4.17	25.3	83.7	54.6	3.53	42.5	4.30	25.2
		100	106.6	54.6	4.79	38.2	3.17	25.7	104.7	55.0	4.67	39.1	3.28	25.6	103.6	55.4	4.56	39.9	3.39	25.5
		130	136.5	55.9	6.43	34.0	2.42	26.1	134.6	56.3	6.27	34.9	2.50	26.0	133.4	56.8	6.11	35.9	2.59	25.9
		135	141.4	56.1	6.81	32.9	2.30	26.2	139.5	56.5	6.64	33.9	2.38	26.1	138.4	56.9	6.47	34.9	2.45	26.0
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
50	10	60	67.9	61.5	2.87	51.7	5.96	38.5	65.9	61.9	2.80	52.4	6.15	38.4	64.6	62.4	2.73	53.1	6.36	38.2
		80	88.0	63.6	3.81	50.6	4.65	38.8	85.9	64.0	3.71	51.4	4.80	38.6	84.6	64.5	3.62	52.2	4.96	38.4
		100	108.0	65.0	4.99	48.0	3.63	39.3	105.8	65.5	4.87	48.9	3.74	39.1	104.5	66.0	4.75	49.8	3.87	38.9
		130	138.0	67.0	6.58	44.6	2.84	40.0	135.7	67.5	6.41	45.6	2.93	39.8	134.4	68.0	6.25	46.7	3.03	39.6
		135	143.0	67.4	6.96	43.7	2.70	40.2	140.7	67.9	6.79	44.7	2.79	40.0	139.4	68.4	6.62	45.8	2.88	39.8
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	15	60	68.1	62.7	2.89	52.8	6.04	41.2	66.0	63.1	2.82	53.5	6.24	41.1	64.7	63.6	2.78	54.1	6.37	41.0
		80	88.2	64.8	3.83	51.7	4.71	41.4	86.0	65.3	3.73	52.5	4.87	41.2	84.7	65.8	3.69	53.2	4.97	41.1
		100	108.2	66.1	5.00	49.0	3.68	41.8	105.9	66.6	4.88	49.9	3.80	41.6	104.6	67.1	4.82	50.6	3.97	41.5
		130	138.1	67.5	6.60	44.9	2.85	42.4	135.8	68.0	6.44	46.0	2.94	42.2	134.4	68.5	6.36	46.8	3.00	42.1
		135	143.1	67.8	6.98	44.0	2.71	42.6	140.8	68.3	6.81	45.1	2.80	42.4	139.4	68.9	6.73	45.9	2.85	42.2
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	20	60	68.3	63.8	2.90	53.9	6.12	43.8	66.1	64.3	2.83	54.7	6.33	43.8	64.8	64.8	2.83	55.1	6.37	43.7
		80	88.4	66.0	3.85	52.9	4.78	44.0	86.1	66.5	3.75	53.7	4.93	43.9	84.8	67.0	3.75	54.2	4.97	43.8
		100	108.3	67.1	5.01	50.0	3.73	44.3	106.0	67.6	4.89	50.9	3.85	44.2	104.7	68.1	4.89	51.5	3.88	44.1
		130	138.1	67.9	6.62	45.3	2.85	44.8	135.8	68.4	6.46	46.4	2.95	44.7	134.4	68.9	6.46	46.9	2.97	44.6
		135	143.1	68.3	7.01	44.4	2.72	44.9	140.8	68.8	6.84	45.5	2.81	44.8	139.4	69.3	6.84	46.0	2.83	44.7
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
70	10	60	69.2	70.4	2.90	60.5	6.76	56.5	67.1	73.5	2.84	63.8	7.21	55.8	65.8	76.6	2.78	67.1	7.68	55.1
		80	89.1	71.3	4.08	57.3	4.86	57.2	87.0	74.8	3.96	61.3	5.26	56.3	85.7	78.3	3.82	65.3	5.70	55.4
		100	109.1	72.3	5.28	54.3	3.82	57.8	107.0	76.5	5.10	59.1	4.17	56.8	105.7	80.7	4.90	64.0	4.59	55.7
		130	139.0	74.5	7.05	50.4	2.94	58.6	137.0	80.1	6.78	57.0	3.29	57.2	135.8	85.7	6.46	63.6	3.69	55.8
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
		140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	15	60	69.5	72.7	2.91	62.7	6.95	59.5	67.2	74.9	2.85	65.1	7.31	59.1	65.8	77.1	2.79	67.6	7.69	58.6
		80	89.4	73.7	4.11	59.7	4.99	60.0	87.1	76.2	3.98	62.7	5.34	59.5	85.8	78.8	3.84	65.7	5.71	58.9
		100	109.4	74.8	5.31	56.7	3.92	60.5	107.1	77.8	5.12	60.3	4.23	59.8	105.7	80.8	4.91	64.0	4.58	59.2
		125	136.9	76.5	6.95	52.8	3.09	61.1	134.6	80.4	6.66	57.7	3.38	60.2	133.3	84.3	6.35	62.6	3.71	59.3
		130	139.3	76.6	7.10	52.4	3.00	62.0	137.1	80.5	6.80	57.3	3.29	61.3	135.7	84.3	6.48	62.2	3.62	60.6
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	20	60	69.8	75.0	2.93	65.0	7.13	62.5	67.3	76.3	2.87	66.5	7.41	62.3	65.9	77.6	2.81	68.0	7.70	62.2
		80	89.8	76.1	4.13	62.0	5.13	62.8	87.3	77.7	4.00	64.0	5.41	62.6	85.8	79.2	3.86	66.1	5.71	62.4
		100	109.7	77.2	5.34	59.0	4.03	63.2	107.2	79.0	5.13	61.5	4.29	62.9	105.7	80.9	4.92	64.1	4.58	62.6
		125	134.7	78.6	6.85	55.2	3.23	63.6	132.2	80.8	6.54	58.4	3.47	63.2	130.7	82.9	6.24	61.7	3.74	62.9
		130	139.7	78.9	7.15	54.5	3.07	63.6	137.2	81.1	6.83	57.8	3.31	63.3	135.6	83.4	6.51	61.2	3.57	62.9
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
90	10	60	70.9	82.6	2.94	72.6	7.83	73.7	68.1	83.3	2.89	73.4	8.03	73.6	66.4	83.9	2.84	74.2	8.23	73.4
		80	91.6	89.0	3.76	76.2	6.59	73.0	88.5	89.7	3.70	77.0	6.75	72.8	86.7	90.3	3.63	77.9	6.93	72.6
		100	111.7	91.7	4.71	75.6	5.42	73.1	108.6	92.4	4.63	76.6	5.56	72.9	106.8	93.1	4.55	77.6	5.70	72.6
		125	136.7	93.3	6.34	71.6	4.16	73.9	133.5	94.0	6.24	72.7	4.26	73.7	131.6	94.7	6.13	73.8	4.37	73.5
		130	141.7	93.6	6.67	70.8	3.90	74.1	138.5	94.3	6.56	71.9	4.00	73.9	136.6	95.0	6.44	73.0	4.10	73.6
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	15	60	71.1	84.2	2.95	74.1	7.94	77.5	68.2	84.9	2.90	75.0	8.14	77.3	66.5	85.5	2.85	75.8	8.35	77.2
		80	91.8	90.7	3.78	77.8	6.68	76.9	88.7	91.4	3.71	78.7	6.85	76.7	86.9	92.1	3.65	79.6	7.02	76.6
		100	112.0	93.2	4.72	77.1	5.49	77.0	108.8	93.9	4.64	78.1	5.63	76.8	106.9	94.7	4.56	79.1	5.78	76.7
		125	136.8	94.0	6.37	72.3	4.18	77.7	133.6	94.7	6.26	73.4	4.28	77.5	131.7	95.4	6.15	74.5	4.36	77.4
		130	141.8	94.2	6.69	71.3	3.92	77.9	138.6	94.9	6.58	72.4	4.01	77.7	136.7	95.6	6.46	73.5	4.12	77.5
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
	20	60	71.3	85.8	2.97	75.7	8.05	81.2	68.4	86.5	2.92	76.5	8.26	81.1	66.7	87.1	2.86	77.3	8.47	81.0
		80	92.0	92.4	3.80	79.4	6.77	80.8	88.9	93.1	3.73	80.4	6.94	80.7	87.0	93.8	3.67	81.3	7.12	80.6
		100	112.2	94.8	4.74	78.6	5.57	80.9	108.9	95.5	4.66	79.6	5.71	80.8	107.0	96.2	4.57	80.6	5.86	80.7
		125	136.9	94.8	6.39	73.0	4.20	81.5	133.7	95.5	6.28	74.1	4.31	81.4	131.8	96.2	6.17	75.1	4.34	81.3
		130	141.9	94.8	6.72	71.8	3.93	81.6	138.6	95.5	6.60	72.9	4.03	81.5	136.7	96.2	6.49	74.1	4.13	81.4
		135	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended				
140	Operation Not Recommended								Operation Not Recommended					Operation Not Recommended						

4/9/25

Shaded area represents LLT above 145°F. Operating the heat pump with a LLT above 145°F results in the compressor running out of envelope and reducing compressor reliability. You may need to increase load water flow or decrease the set point. Increasing the load water flow will lower the discharge pressure and compressor temperature.

Load flow may have to be adjusted based on source temperature variations.

©2025 The manufacturer works continually to improve its products. As a result,

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



Performance Data cont.

060-Cooling

Source		Load Flow - 10 GPM								Load Flow - 15 GPM					Load Flow - 20 GPM					
EST °F	Flow GPM	ELT °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F	LLT °F	TC MBTUH	Power kW	HR MBTUH	EER	LST °F
50	10	50	39.4	48.6	2.83	58.2	16.3	61.8	42.7	49.3	2.84	59.0	16.5	62.0	44.3	49.9	2.85	59.7	16.6	62.1
		70	58.4	52.5	2.87	62.3	17.4	62.7	61.9	53.1	2.88	62.9	17.5	62.8	63.7	53.7	2.89	63.5	17.7	62.9
		90	77.3	56.5	2.92	66.4	18.4	63.5	81.2	57.0	2.92	66.9	18.6	63.6	83.1	57.4	2.92	67.4	18.7	63.7
		110	96.3	60.5	2.96	70.6	19.4	64.4	100.4	60.8	2.96	70.9	19.6	64.5	102.5	61.2	2.95	71.3	19.7	64.6
	15	50	39.6	47.5	2.75	56.8	16.4	57.6	42.8	48.2	2.76	57.6	16.6	57.7	44.4	48.8	2.77	58.3	16.7	57.8
		70	58.6	51.1	2.78	60.6	17.4	58.1	62.1	51.7	2.79	61.2	17.6	58.2	63.9	52.3	2.80	61.8	17.8	58.3
		90	77.7	54.7	2.81	64.3	18.5	58.6	81.4	55.2	2.82	64.8	18.6	58.7	83.3	55.7	2.82	65.4	18.8	58.8
		110	96.7	58.4	2.84	68.1	19.5	59.1	100.7	58.8	2.85	68.5	19.6	59.2	102.7	59.2	2.85	68.9	19.7	59.2
	20	50	39.8	46.3	2.68	55.5	16.5	55.4	43.0	47.0	2.68	56.2	16.7	55.5	44.5	47.8	2.69	56.9	16.9	55.6
		70	58.9	49.7	2.69	58.9	17.5	55.8	62.3	50.3	2.70	59.5	17.7	55.9	64.0	50.9	2.71	60.1	17.8	55.9
		90	78.1	53.0	2.71	62.2	18.6	56.2	81.7	53.5	2.72	62.8	18.7	56.2	83.5	54.0	2.73	63.3	18.8	56.3
		110	97.2	56.3	2.73	65.6	19.6	56.5	101.0	56.7	2.74	66.0	19.7	56.6	102.9	57.1	2.75	66.5	19.8	56.6
70	10	50	40.0	45.4	3.50	57.4	12.3	81.5	43.1	46.3	3.52	58.3	12.5	81.7	44.6	47.2	3.53	59.2	12.7	81.9
		70	58.7	51.0	3.57	63.2	13.6	82.7	62.1	51.8	3.58	64.0	13.7	82.9	63.8	52.6	3.59	64.9	13.9	83.1
		90	77.3	56.7	3.64	69.1	14.8	84.0	81.1	57.3	3.65	69.8	14.9	84.1	83.1	58.0	3.66	70.5	15.1	84.2
		110	95.9	62.3	3.71	74.9	15.9	85.2	100.2	62.8	3.72	75.5	16.1	85.3	102.3	63.4	3.72	76.1	16.2	85.4
	15	50	40.2	44.8	3.41	56.4	12.5	77.4	43.2	45.7	3.43	57.4	12.7	77.5	44.6	46.6	3.44	58.3	12.9	77.6
		70	58.9	50.1	3.47	62.0	13.7	78.1	62.2	50.9	3.48	62.8	13.9	78.3	63.9	51.7	3.49	63.6	14.1	78.4
		90	77.5	55.5	3.52	67.5	15.0	78.9	81.3	56.2	3.53	68.2	15.1	79.0	83.2	56.8	3.54	68.9	15.3	79.1
		110	96.2	60.8	3.57	73.0	16.2	79.7	100.4	61.4	3.58	73.6	16.3	79.8	102.4	61.9	3.59	74.2	16.4	79.8
	20	50	40.3	44.1	3.33	55.5	12.6	75.3	43.2	45.1	3.34	56.5	12.8	75.4	44.7	46.0	3.35	57.4	13.1	75.5
		70	59.0	49.2	3.36	60.7	13.9	75.9	62.3	50.0	3.37	61.5	14.1	75.9	64.0	50.8	3.38	62.4	14.3	76.0
		90	77.8	54.3	3.40	65.9	15.2	76.4	81.5	55.0	3.41	66.6	15.3	76.5	83.3	55.6	3.42	67.3	15.5	76.5
		110	96.5	59.4	3.43	71.1	16.5	76.9	100.6	59.9	3.44	71.7	16.5	77.0	102.6	60.4	3.46	72.2	16.6	77.1
90	10	50	40.7	42.3	4.17	56.5	9.6	101.2	43.5	43.4	4.19	57.7	9.8	101.4	44.9	44.4	4.21	58.8	10.0	101.7
		70	59.0	49.6	4.27	64.1	11.0	102.8	62.3	50.5	4.28	65.1	11.2	103.0	63.9	51.5	4.30	66.2	11.4	103.2
		90	77.3	56.8	4.37	71.7	12.4	104.4	81.1	57.7	4.38	72.6	12.5	104.6	83.0	58.5	4.39	73.5	12.7	104.7
		110	95.5	64.1	4.47	79.3	13.6	105.9	99.9	64.8	4.48	80.1	13.8	106.1	102.1	65.6	4.49	80.9	13.9	106.3
	15	50	40.7	42.1	4.07	56.0	9.8	97.2	43.5	43.2	4.09	57.2	10.0	97.3	44.9	44.3	4.11	58.4	10.3	97.5
		70	59.1	49.2	4.15	63.3	11.3	98.2	62.3	50.1	4.16	64.4	11.4	98.3	64.0	51.1	4.18	65.4	11.6	98.5
		90	77.4	56.2	4.22	70.6	12.6	99.2	81.2	57.1	4.24	71.5	12.8	99.3	83.1	57.9	4.25	72.4	12.9	99.5
		110	95.7	63.3	4.30	78.0	14.0	100.2	100.0	64.0	4.31	78.7	14.1	100.3	102.2	64.7	4.33	79.4	14.2	100.4
	20	50	40.8	41.9	3.98	55.5	10.0	95.2	43.5	43.1	3.99	56.7	10.3	95.3	44.9	44.3	4.01	57.9	10.5	95.4
		70	59.1	48.8	4.03	62.5	11.5	95.9	62.4	49.8	4.05	63.6	11.7	96.0	64.0	50.8	4.06	64.6	11.9	96.1
		90	77.5	55.6	4.08	69.6	12.9	96.6	81.3	56.5	4.10	70.4	13.1	96.7	83.1	57.3	4.11	71.3	13.2	96.8
		110	95.9	62.5	4.14	76.6	14.4	97.4	100.1	63.1	4.15	77.3	14.4	97.4	102.3	63.7	4.17	78.0	14.5	97.5
110	10	50	41.3	39.2	4.83	55.7	7.7	120.9	43.9	40.4	4.86	57.0	7.9	121.1	45.2	41.7	4.89	58.4	8.1	121.4
		70	59.3	48.1	4.96	65.0	9.2	122.8	62.5	49.2	4.99	66.2	9.4	123.1	64.0	50.4	5.01	67.5	9.6	123.3
		90	77.2	57.0	5.09	74.3	10.6	124.8	81.0	58.0	5.11	75.5	10.8	125.0	82.9	59.1	5.13	76.6	10.9	125.2
		110	95.2	65.9	5.22	83.7	12.0	126.7	99.6	66.8	5.24	84.7	12.1	126.9	101.8	67.8	5.25	85.7	12.3	127.2
	15	50	41.3	39.4	4.73	55.6	7.9	117.0	43.8	40.8	4.75	57.0	8.1	117.2	45.1	42.1	4.78	58.4	8.4	117.4
		70	59.3	48.2	4.83	64.7	9.5	118.2	62.4	49.4	4.85	65.9	9.7	118.4	64.0	50.5	4.87	67.2	9.9	118.6
		90	77.2	57.0	4.93	73.8	11.0	119.5	81.0	58.0	4.95	74.9	11.1	119.7	83.0	59.0	4.97	75.9	11.3	119.8
		110	95.2	65.7	5.03	82.9	12.4	120.8	99.6	66.6	5.05	83.8	12.5	120.9	101.9	67.4	5.06	84.7	12.7	121.0
	20	50	41.2	39.7	4.63	55.5	8.2	115.0	43.8	41.1	4.65	57.0	8.4	115.2	45.1	42.5	4.67	58.4	8.7	115.3
		70	59.2	48.4	4.70	64.4	9.8	116.0	62.4	49.5	4.72	65.6	10.0	116.1	64.0	50.7	4.74	66.9	10.2	116.2
		90	77.2	57.0	4.77	73.3	11.3	116.9	81.1	57.9	4.79	74.3	11.5	117.0	83.0	58.9	4.81	75.3	11.6	117.1
		110	95.2	65.6	4.84	82.1	12.9	117.8	99.7	66.3	4.86	82.9	13.0	117.9	101.9	67.1	4.88	83.7	13.1	118.0

4/9/25

©2025 The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____



Revision Guide

Pages:	Description:	Date:	By:
	Guide Creation	5 May, 2025	SW